


WARD FIRE DAMPER

Fire Damper and Sleeve Assembly
FOR USE WITH ALL FIRE DAMPERS

FDS S

SPECIFICATIONS:

1. Formed metal locked seam sleeve
2. Fire damper (sold separately or factory installed in the sleeve)

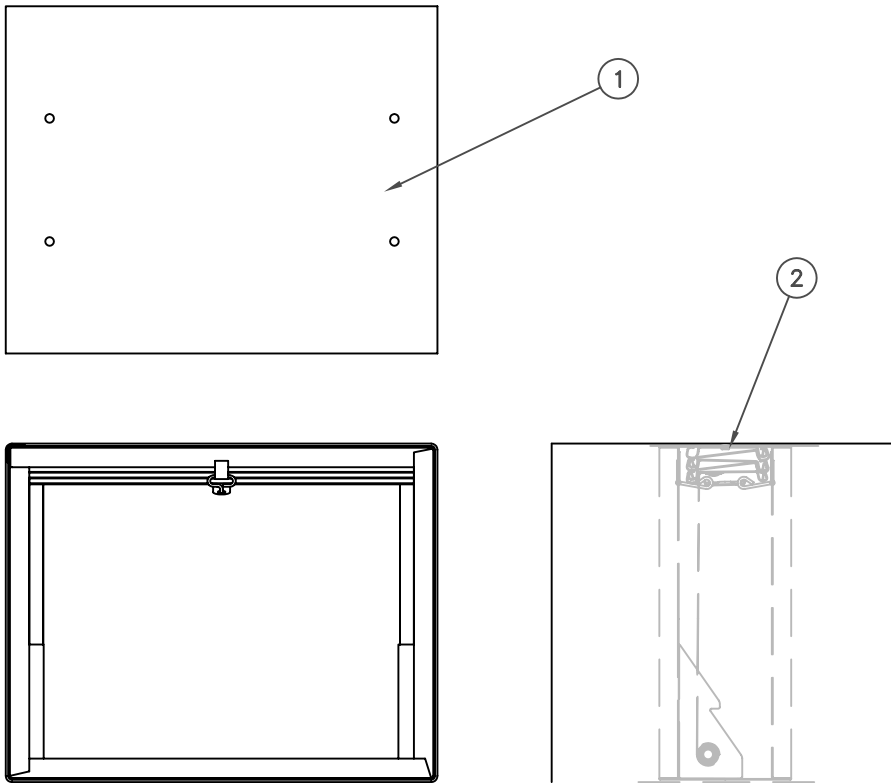

NOTES:

1. Available in the following materials:
 - Galvanized
 - Stainless Steel
2. Available in the following lengths:
 - 8"
 - 12"
 - 16"
 - 20"
3. Available in the following gauges:
 - 14
 - 16
 - 18
 - 20
 - 22
4. Provides a fastening site for ductwork leading to a damper.
5. Provides a platform to which retaining angle can be mounted.
6. Damper can be ordered off-set from center for sidewall applications.
7. For installation instructions see Sleeve Installation Instructions.

| | |
|-------------------|---------------------|
| JOB NAME: _____ | SUBMITTED BY: _____ |
| LOCATION: _____ | |
| ARCHITECT: _____ | |
| ENGINEER: _____ | |
| CONTRACTOR: _____ | |



500 E. Eighth Street • Holland, MI 49423
T (800) 466-9374 • F (866) 466-9335 • www.wardind.com